

PRODUCT SUBMITTAL SHEET



| Capacities |
|--|
| 1500, 2000, 3000, 3600 4000 or 4800 Watts 120, 208, 240, 277, 347 or 600V @ 1Ø or 3Ø |
| Thermostat Range: 40° - 90° F Air Movement: 100 CFM |


LFK SERIES FAN-FORCED WALL HEATERS

Job Name: _____
 Location: _____
 Architect: _____
 Engineer: _____
 Contractor: _____
 Submitted By: _____
 Date: _____

| | |
|---------------|-------|
| Submitted By: | Date: |
| | |
| | |
| | |
| Approved By: | Date: |
| | |
| | |
| | |

| Item | QTY | Catalog Number | Tag | Watts | Volts | PH | AMPS | Weight |
|------|-----|----------------|-----|-------|-------|----|------|--------|
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |


| ACCESSORIES | | | |
|-------------|-----|-------------|-----|
| Item | QTY | Part Number | Tag |
| | | | |
| | | | |
| | | | |

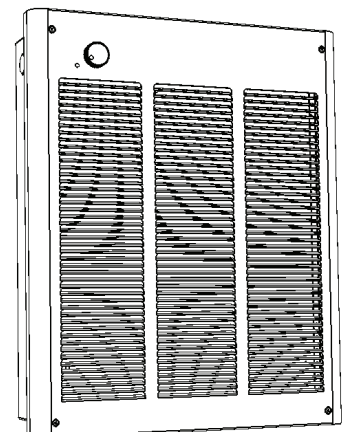

Marley
Engineered Products
 470 Beauty Spot Road East
 Bennettsville, South Carolina 29512
 www.marlemep.com



| Catalog Number | Volts | Amps | Watts | Phase | BTU/HR |
|----------------|---|-----------|-----------|-------|---------------|
| LFK151F | 120 | 12.5 | 1500 | 1 | 1705 |
| LFK204F | 240/208 | 8.3/7.2 | 2000/1500 | 1 | 6820/1705 |
| LFK303F | 347 | 8.6 | 3000 | 1 | 10,230 |
| LFK304F | 240 | 12.5 | 3000 | 1 | 10,230 |
| LFK306F | 600 | 5.0 | 3000 | 1 | 10,230 |
| LFK403F | 347 | 11.5 | 4000 | 1 | 13,640 |
| LFK404F | 240/208 | 16.7/14.4 | 4000/3000 | 1 | 13,640/10,230 |
| LFK406F | 600 | 6.7 | 4000 | 1 | 13,640 |
| LFK408F | 208 | 19.2 | 4000 | 1 | 13,640 |
| LFK483F | 347 | 13.8 | 4800 | 1 | 16,638 |
| LFK484F | 240/208 | 20/17.3 | 4800/3600 | 1 | 16,638/12,276 |
| LFK486F | 600 | 8.0 | 4800 | 1 | 16,638 |
| LFK4083F | 208 | 11.1 | 4000 | 3 | 13,640 |
| LFK487F | 277/240 | 17.3/15 | 4800/3600 | 1 | 16,638/12,276 |
| LFK488F | 208 | 23.1 | 4800 | 1 | 16,638 |
| LFK4883F | 208 | 13.3 | 4800 | 3 | 16,638 |
| Accessories | | | | | |
| LFKSM | Surface mounting frame for surface installations. 3-13/16" deep | | | | |
| LFKS1 | 1" deep surface mounting frame for semi-recessed installation | | | | |
| LFKS2 | 2" deep surface mounting frame for semi-recessed installation | | | | |
| LFKSFC | 14 gauge security front cover | | | | |

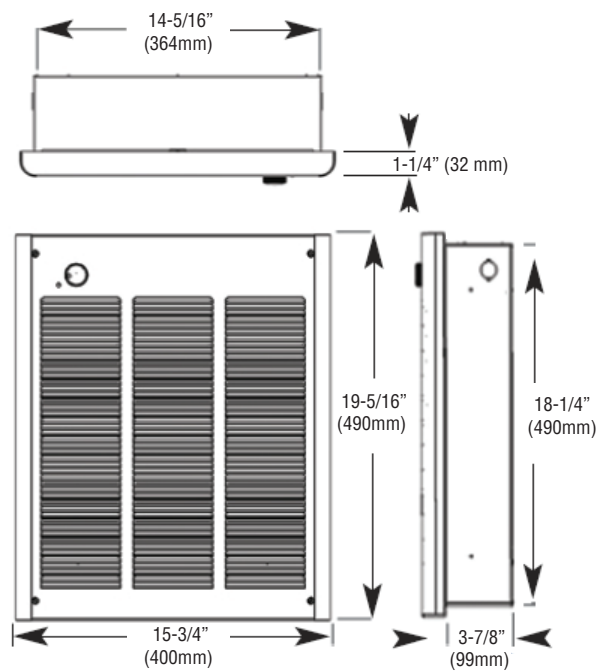

ARCHITECT'S AND ENGINEER'S SPECIFICATIONS*

The heating equipment shall include an electric automatic fan forced air heater suitable for small area heating, as manufactured by QMark®, a Marley Engineered Products® Brand, Bennettsville, SC. The heater shall be designed for wall mounting, recess or surface. Heaters shall be cETLus listed.

BACK BOX: The back box shall be designed as a recessed rough-in box in either masonry or frame installations and is also used when surface mounting frames are used in surface mounting installations. The back box shall be heavy gauge galvanized steel and shall contain knockouts through which power leads enter.

INNER FRAME ASSEMBLY: The heater assembly, which fits into the back box, shall consist of a heavy gauge steel fan panel to which all of the operational parts of the heater are mounted. The inner frame assembly shall be completely pre-wired.

HEATING ELEMENT: The heating element shall be of the non-glowing design consisting of an 80/20 nickel-chromium resistance wire enclosed in a steel sheath to which plate fins are copper brazed. The element shall cover the entire air discharge area to ensure uniform heating of all discharged air. It shall be warranted for 5 years.

MOTOR AND CONTROLS: The fan motor shall be totally enclosed, impedance protected, permanently lubricated and with a totally enclosed rotor. Fan control shall be of the bi-metallic, snap-action type and shall activate fan after heating element reaches operating temperature, and continue to operate the fan after the thermostat is satisfied and until all heated air has been discharged. The thermostat shall be single-pole type on all models. Thermal cutout shall be bi-metallic, snap-action type designed to shut off heat in the event of overheating. The fan shall be five-bladed aluminum.

SURFACE MOUNTING FRAME: The surface mounting frame shall be of heavy gauge steel designed to mount around the back box for a finished surface installation. Slot knock outs shall be provided for power supply conduit.

FRONT COVER: The louvered front cover shall be of heavy gauge steel with a powder paint finish. A plug button will be provided to replace the thermostat knob and render the unit tamper-resistant.

FINISH: All sheet metal parts, except the galvanized steel back box, shall be phosphatized, then completely painted by a powder paint process.

**In the interest of continual improvements in product and performance, Marley Engineered Products reserves the right to change specifications without notice.*